

**Company: Joyoung International Trading Co., Limited**  
**Atten: Smiling**  
**Mobile/WhatsApp/Wechat: +86 18050035902**  
**E-mail: info@htechplc.com**  
**Website: <https://www.joyoungintl.com/>**

# 3500/62 Process Variable Monitor

## Datasheet

Bently Nevada Machinery Condition Monitoring

141541 Rev. N

### Description

The 3500/62 Process Variable Monitor is a 6-channel monitor for processing machine critical parameters that merit continuous monitoring, such as pressures, flows, temperatures, and levels. The monitor accepts +4 to +20 mA current inputs or any proportional voltage inputs between -10 Vdc and +10 Vdc. It conditions these signals and compares the conditioned signals to user-programmable alarm setpoints.

The 3500/62 monitor:

- Continuously compares monitored parameters against configured alarm setpoints to drive alarms for machinery protection.
- Provides essential machine information for both operations and maintenance personnel.

You can program the 3500/62 using the 3500 Rack Configuration Software to perform either current or voltage measurements. The 3500/62 offers I/O modules for three signal input scenarios: +/-10 Volts DC, isolated 4-20 mA, or 4-20 mA with Intrinsically Safe zener barriers. The Internal Barrier I/O provides external power input terminals to provide intrinsically safe power to the 4-20 mA transducers

When used in a Triple Modular Redundant (TMR) configuration, you must install Process Variable Monitors adjacent to each other in groups of three. When used in this configuration, the monitor employs two types of voting to ensure accurate operation and to avoid loss of machinery protection due to single-point failures.



Triple Modular Redundant (TMR) Units are no longer available for purchase.



## Specifications

### Inputs

| Signal                                                      |                                         |
|-------------------------------------------------------------|-----------------------------------------|
| +/-10 Vdc I/O                                               | -10 Vdc to +10 Vdc                      |
| 4-20 mA Barrier I/O                                         | 4-20 mA DC                              |
| 4-20 mA Isolated I/O                                        | 4-20 mA DC.                             |
| Voltage Compliance<br>(4-20 mA Barrier I/O<br>4-20mA out)   | 13.66 V                                 |
| Isolation<br>(4-20 mA ISO I/O<br>only)                      | 500 Volts                               |
| Input Impedance                                             |                                         |
| +/-10V I/O                                                  | 1 M $\Omega$                            |
| 4-20 mA Barrier I/O                                         | 50 $\Omega$                             |
| 4-20 mA Isolated I/O                                        | 50 $\Omega$                             |
| Power Consumption                                           | 7.0 Watts, typical.                     |
| External transducer<br>Power (Internal<br>Barrier I/O Only) | +24 Vdc. +/- 5% @ 250<br>mA max. Fused. |

### Outputs

| Front Panel LEDs |                                                                                                   |
|------------------|---------------------------------------------------------------------------------------------------|
| OK LED           | Indicates when the Process Variable Monitor is operating properly.                                |
| TX/RX LED        | Indicates when the Process Variable Monitor is communicating with other modules in the 3500 rack. |
| Bypass LED       | Indicates when the Process Variable is in Bypass Mode.                                            |

## Signal Conditioning



Specified at +25°C (+77°F). Full-scale range for each channel is set in the field via 3500 Configuration Software. No calibration is required.

|                  |                                                                                                                 |
|------------------|-----------------------------------------------------------------------------------------------------------------|
| Accuracy         | Within $\pm 0.33\%$ of full-scale typical, $\pm 1\%$ maximum.                                                   |
| Full Scale Range | Maximum 20,000 units mapped over the input signal span. Minimum input signal span for voltage input is 2 Volts. |

## Alarms

### Alarm Setpoints

User can set Alert and Danger setpoints for the value measured by the monitor. Alarms are adjustable and can normally be set from 0 to 100% of full-scale for each measured value. The exception is when the full-scale range exceeds the range of the sensor in which case the setpoint will be limited to the range of the sensor. Accuracy of alarms is to within 0.13% of the desired value. The Process Variable Monitor has both under and over alarm setpoints.

### Alarm Time Delays

User can use software to set alarm delays as follows:

|        |                                               |
|--------|-----------------------------------------------|
| Alert  | From 1 to 60 seconds in 1 second intervals.   |
| Danger | From 1 to 60 seconds in 0.5 second intervals. |

## Proportional Values

Proportional values are Process Variable measurements used to monitor the machine. The Process Variable Monitor returns current or voltage proportional values in a variety of different units that are configurable.

## Environmental Limits

|                       |                                                                                                   |
|-----------------------|---------------------------------------------------------------------------------------------------|
| Operating Temperature | -30°C to +65°C (-22°F to +149°F) when used with Internal/External Termination I/O Module.         |
| Operating Temperature | 0°C to +65°C (+32°F to +149°F) when used with Internal Barrier I/O Module (Internal Termination). |
| Storage Temperature   | 40°C to +85°C (-40°F to +185°F).                                                                  |
| Humidity              | 95%, noncondensing.                                                                               |

## Monitor Module

|                                     |                                                              |
|-------------------------------------|--------------------------------------------------------------|
| Dimensions (height x width x depth) | 241.3 mm x 24.4 mm x 241.8 mm<br>9.50 in x 0.96 in x 9.52 in |
| Weight                              | 0.82 kg (1.8 lbm)                                            |

### I/O Modules (without barriers)

|                                     |                                                               |
|-------------------------------------|---------------------------------------------------------------|
| Dimensions (height x width x depth) | 241.3 mm x 24.4 mm x 99.1 mm<br>(9.50 in x 0.96 in x 3.90 in) |
| Weight:                             | 0.20 kg (0.44 lbm)                                            |

### I/O Module (with barriers)

|                                     |                                                               |
|-------------------------------------|---------------------------------------------------------------|
| Dimensions (height x width x depth) | 241.3 mm x 24.4 mm x 99.1 mm<br>(9.50 in x 0.96 in x 3.90 in) |
| Weight                              | 0.46 kg (1.01 lbm)                                            |

## Rack Space Requirements

|                |                           |
|----------------|---------------------------|
| Monitor Module | 1 full-height front slot. |
| I/O Modules    | 1 full-height rear slot.  |

## Compliance and Certifications

### FCC

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:

- This device may not cause harmful interference.
- This device must accept any interference received, including interference that may cause undesired operation.

### EMC

European Community Directive:

EMC Directive 2014/30/EU

Standards:

EN 61000-6-2; Immunity for  
Industrial Environments  
EN 61000-6-4; Emissions for  
Industrial Environments

### Electrical Safety

European Community Directive:

LV Directive 2014/35/EU

Standards:

EN 61010-1

### RoHS

European Community Directive:

RoHS Directive 2011/65/EU

### Maritime

DNV GL rules for classification – Ships,  
offshore units, and high speed and light  
craft

ABS Rules for Condition of Classification,  
Part 1

- Steel Vessels Rules
- Offshore Units and Structures

## Hazardous Area Approvals



For the detailed listing of country and product-specific approvals, refer to the [Approvals Quick Reference Guide \(108M1756\)](#).

For additional technical documentation, please log in to [bntechsupport.com](http://bntechsupport.com) and access the Bently Nevada Media Library.

### cNRTLus

|                                                                      |                                                                                                                                                                                                                                                                              |
|----------------------------------------------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| When used with I/O module ordering options without internal barriers | Class I, Zone 2: AEx/Ex nA nC ic IIC T4 Gc;<br>Class I, Zone 2: AEx/Ex ec nC ic IIC T4 Gc;<br>Class I, Division 2, Groups A, B, C, and D;<br><br>T4 @ Ta= -20°C to +65°C (-4°F to +149°F)<br>When installed per drawing 149243 or 149244.                                    |
| When used with I/O module ordering options with internal barriers    | Class I, Zone 2: AEx/Ex nA nC ic [ia Ga] IIC T4 Gc;<br>Class I, Zone 2: AEx/Ex ec nC ic [ia Ga] IIC T4 Gc;<br>Class I, Division 2, Groups A, B, C, and D (W/ IS Output for Division 1)<br><br>T4 @ Ta= -20°C to +65°C (-4°F to +149°F)<br>When installed per drawing 138547. |

**ATEX/IECEx**

|                                                                      |                                                                                                                                                                                                                                                                            |
|----------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| When used with I/O module ordering options without internal barriers | <div></div> <p>II 3 G</p> <p>Ex nA nC ic IIC T4 Gc;<br/>Ex ec nC ic IIC T4 Gc;</p> <p>T4 @ Ta= -20°C to +65°C (-4°F to +149°F)<br/>When installed per drawing 149243 or 149244.</p>       |
| When used with I/O module ordering options with internal barriers    | <div></div> <p>II 3(1) G</p> <p>Ex nA nC ic [ia Ga] IIC T4 Gc;<br/>Ex ec nC ic [ia Ga] IIC T4 Gc;<br/>T4 @ Ta= -20°C to +65°C (-4°F to +149°F)<br/>When installed per drawing 138547.</p> |

## Ordering Considerations

### General

If the 3500/62 Module is added to an existing 3500 Monitoring System, the monitor requires the following (or later) firmware and software versions:

- 3500/20 Module Firmware – 1.07 (Rev G)
- 3500/01 Software – Version 2.20
- 3500/02 Software – Version 2.10
- 3500/03 Software – Version 1.20

If the Internal Barrier I/O is used the system must also meet these requirements:

- 3500/62 Module Firmware- 1.06 (Rev C)
- 3500/01 Software – Version 2.30



You cannot use External Termination Blocks with Internal Termination I/O modules.

When ordering I/O Modules with External Terminations, you must order the External Termination Blocks and Cables separately.

### Internal Barrier I/O Module

|                |                                                                                                                          |
|----------------|--------------------------------------------------------------------------------------------------------------------------|
| Important info | Consult the 3500 Internal Barrier specification sheet (part number 141495-01) if you select the Internal Barrier Option. |
| Fuse           | 250 mA, 250 V fast blow type.                                                                                            |

## Ordering Information



For the detailed listing of country and product-specific approvals, refer to the [Approvals Quick Reference Guide \(108M1756\)](#).

For additional technical documentation, please log in to [bntechsupport.com](http://bntechsupport.com) and access the Bently Nevada Media Library.

## Process Variable Monitor

### 3500/62-AA-BB

#### A: I/O Module Type

|           |                                                                                       |
|-----------|---------------------------------------------------------------------------------------|
| <b>01</b> | -10 to +10 Vdc I/O Module with Internal Terminations                                  |
| <b>02</b> | -10 to +10 Vdc I/O Module with External Terminations                                  |
| <b>03</b> | Isolated +4 to +20 mA I/O Module with Internal Terminations                           |
| <b>04</b> | Isolated +4 to +20 mA I/O Module with External Terminations                           |
| <b>05</b> | Non-Isolated +4 to +20 mA I/O Module with Internal Barriers and Internal Terminations |

#### B: Agency Approval Option

|           |                            |
|-----------|----------------------------|
| <b>00</b> | None                       |
| <b>01</b> | cNRTLus                    |
| <b>02</b> | ATEX/CSA (Class 1, Zone 2) |



Agency Approval Option B 02 is available only with Ordering Options A 01 and A 05.

## External Termination Blocks

|           |                                                                 |
|-----------|-----------------------------------------------------------------|
| 136595-01 | 3500/62 External Termination Block (Terminal Strip Connectors). |
| 136603-01 | 3500/62 External Termination Block (Euro Style Connectors).     |

## Cables

### 3500/62 Transducer (XDCR) Signal to External Termination (ET) Block Cable

#### 134544-AAAA-BB

##### A: Cable Length

|             |                        |
|-------------|------------------------|
| <b>0005</b> | 5 feet (1.5 metres)    |
| <b>0007</b> | 7 feet (2.1 metres)    |
| <b>0010</b> | 10 feet (3 metres)     |
| <b>0025</b> | 25 feet (7.5 metres)   |
| <b>0050</b> | 50 feet (15 metres)    |
| <b>0100</b> | 100 feet (30.5 metres) |

##### B: Assembly Instructions


|           |               |
|-----------|---------------|
| <b>01</b> | Not assembled |
| <b>02</b> | Assembled     |

## Spares

| Part Number | Description                                              |
|-------------|----------------------------------------------------------|
| 163179-03   | 3500/62 monitor                                          |
| 136590-01   | Firmware IC                                              |
| 04425545    | Grounding wrist strap (single use)                       |
| 04400037    | IC removal tool                                          |
| 136491-01   | -10 Vdc to +10 Vdc I/O Module with internal terminations |

| Part Number | Description                                                        |
|-------------|--------------------------------------------------------------------|
| 136499-01   | -10 Vdc to +10 Vdc I/O Module with external terminations           |
| 136294-01   | Isolated +4 to +20 mA I/O Module with internal terminations        |
| 136483-01   | Isolated +4 to +20 mA I/O Module with external terminations        |
| 137110-01   | 4 to 20 mA Barrier I/O Module with internal terminations           |
| 136973      | 3500/62 User Guide                                                 |
| 01700059    | Replacement fuse for barrier I/O                                   |
| 166M2377    | Connector Header Push-in-Spring Type (Alternative for PN 00580442) |

## Graphs and Figures

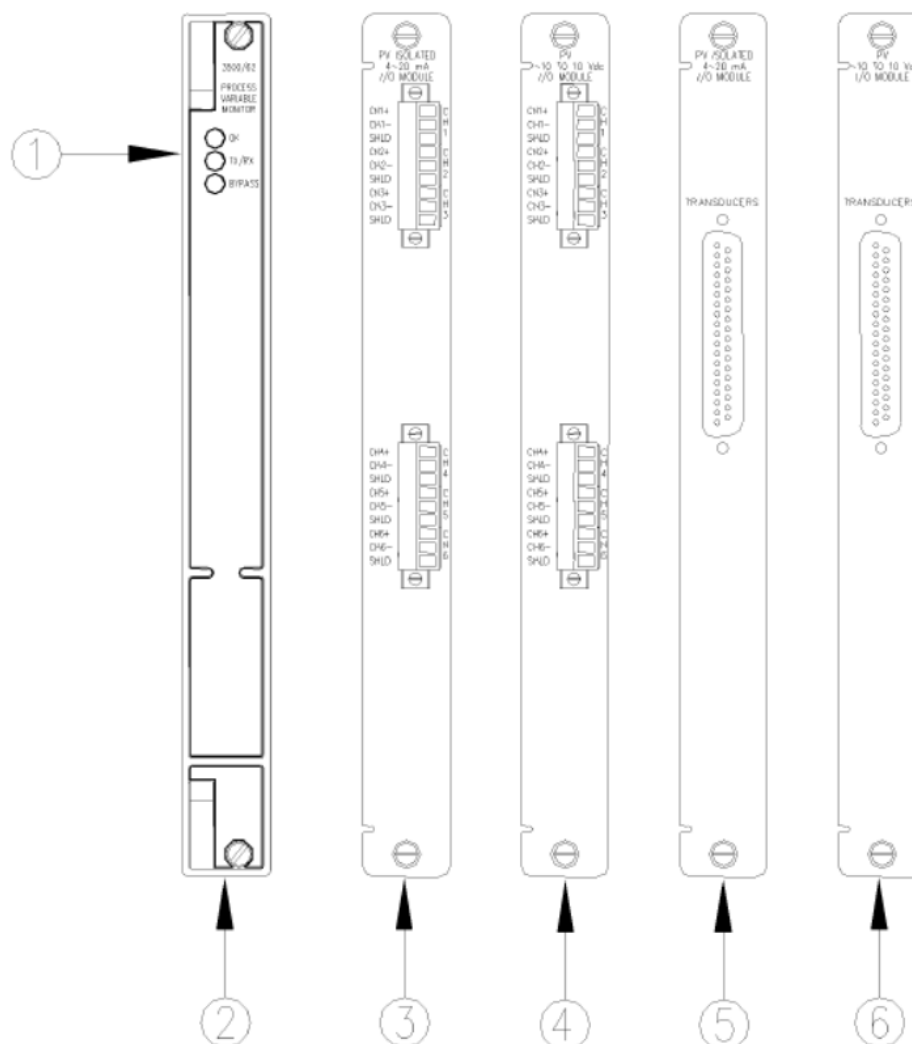

1. Status LEDs
2. Main Module Front View
3. 4 to 20mA Internal Terminations I/O Module
4. -10 to +10 Vdc Internal Terminations I/O Module
5. 4 to 20mA External Terminations I/O Module
6. -10 to +10 Vdc External Terminations I/O Module

**Figure 1: Front and Rear Views of the 3500/62 Process Variable Monitor**



Copyright 2024 Baker Hughes Company. All rights reserved.



Bently Nevada, M2 and Orbit Logo are registered trademarks of Bently Nevada, a Baker Hughes business, in the United States and other countries. The Baker Hughes logo is a trademark of Baker Hughes Company. All other product and company names are trademarks of their respective holders. Use of the trademarks does not imply any affiliation with or endorsement by the respective holders.

Baker Hughes provides this information on an "as is" basis for general information purposes. Baker Hughes does not make any representation as to the accuracy or completeness of the information and makes no warranties of any kind, specific, implied or oral, to the fullest extent permissible by law, including those of merchantability and fitness for a particular purpose or use. Baker Hughes hereby disclaims any and all liability for any direct, indirect, consequential or special damages, claims for lost profits, or third party claims arising from the use of the information, whether a claim is asserted in contract, tort, or otherwise. Baker Hughes reserves the right to make changes in specifications and features shown herein, or discontinue the product described at any time without notice or obligation. Contact your Baker Hughes representative for the most current information.

The information contained in this document is the property of Baker Hughes and its affiliates; and is subject to change without prior notice. It is being supplied as a service to our customers and may not be altered or its content repackaged without the express written consent of Baker Hughes. This product or associated products may be covered by one or more patents. See [Bentley.com/legal](https://www.bentley.com/legal).

1631 Bently Parkway South, Minden, Nevada USA 89423  
Phone: 1.775.782.3611 (US) or [Bentley.com/support](https://www.bentley.com/support)  
[Bentley.com](https://www.bentley.com)